


DETAIL C

TYPICAL INTERIOR DOWN-CONDUCTOR AND GROUNDING DETAIL (REINFORCED CONCRETE)

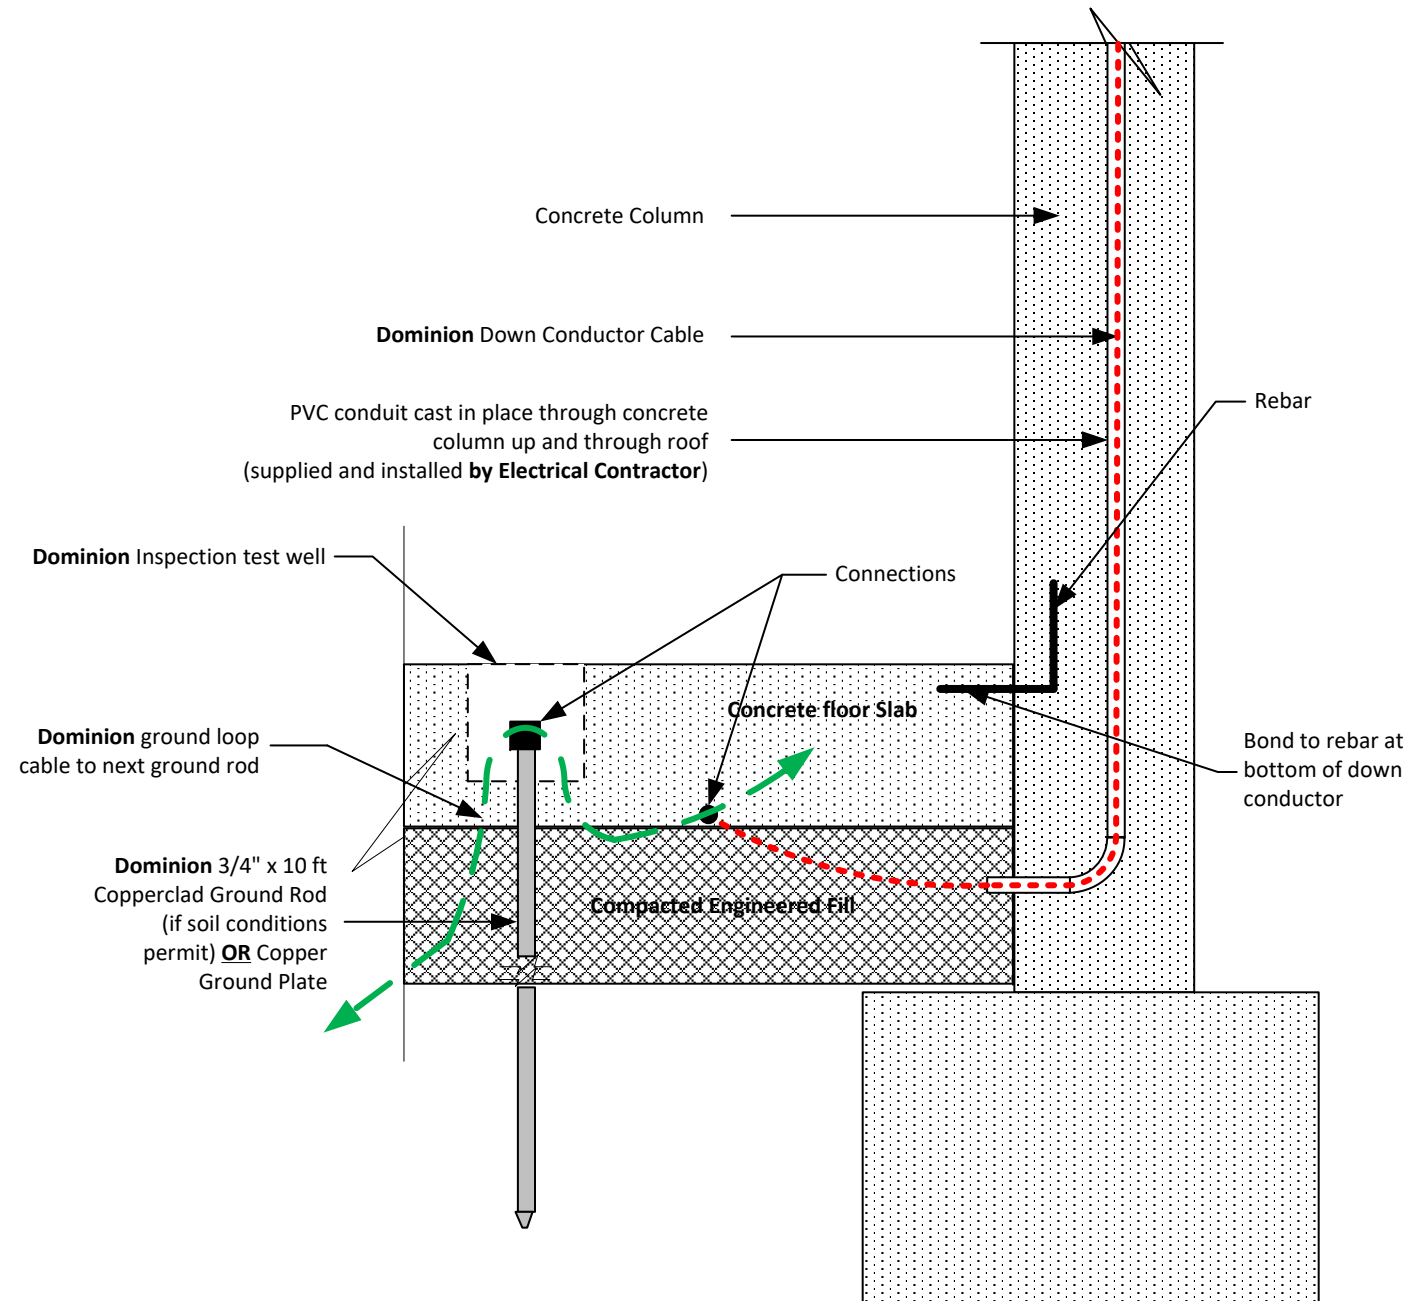

NOTES

1. Conduit paths shall take most direct route possible and minimize bends
2. Where bends cannot be avoided, conduit bends shall be a minimum 8" radius bend
3. PVC conduit must be continuous with no gaps and run up and through roof structure
4. Conduits shall be free & clear of any obstructions
5. Conduits shall be installed with continuous pull string for installation of down-conductor cables



LIGHTNING PROTECTION LAYOUT FOR :
TYPICAL DETAILS

DRAWN BY : RCC

REV

APPROVED BY: AGW

0

DATE:

SCALE: AS SHOWN

PAGE 3 of 8